


REVISION OF CITY OF BEAVERTON STANDARD DRAWING NO. 641 11-15-04

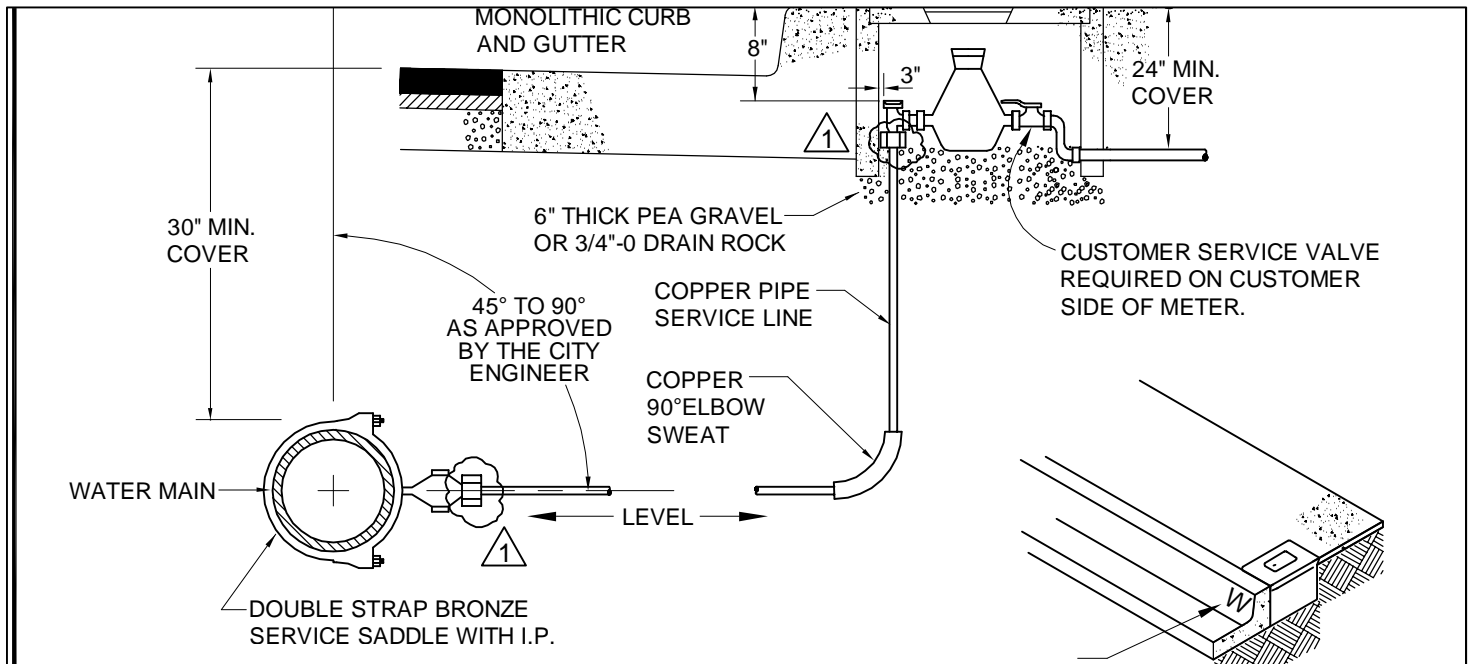

1. Bronze strainer to be used for 2-inch turbo meters.
2. Water service and meter to be installed by developer.
3. Top of meter box to be set flush with sidewalk or top of curb.
4. Corporation and curb stops to be Mueller 300 ball valves, 300 psi rated, with Mueller 110 compression joints and padlock wings (or identical equal). Corporation stop to be installed with

installations.

12. All meter boxes located in driveways and sidewalks shall have traffic covers.
13. On compression connections, cut the pipe end straight, chamfer and clean prior to inserting into the fitting; tighten the compression nut until it makes metal-to-metal contact with the machine shoulder of the stop or fitting.

**ATTENTION! THIS DRAWING REPLACES
DRAWING NO. 641, DATED 6-10-04**

1 CHANGED NOTE #4 TO SPECIFY 'MUELLER 300 BALL VALVES, 300 PSI RATED, WITH MUELLER 110 COMPRESSION JOINTS AND PADLOCK WINGS (OR IDENTICAL EQUAL)', INSTEAD OF FLARED FITTINGS. ADDED NOTE #13. CHANGED DRAWING TO SHOW COMPRESSION JOINTS.